
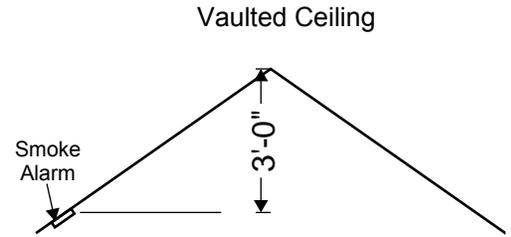


Building Department

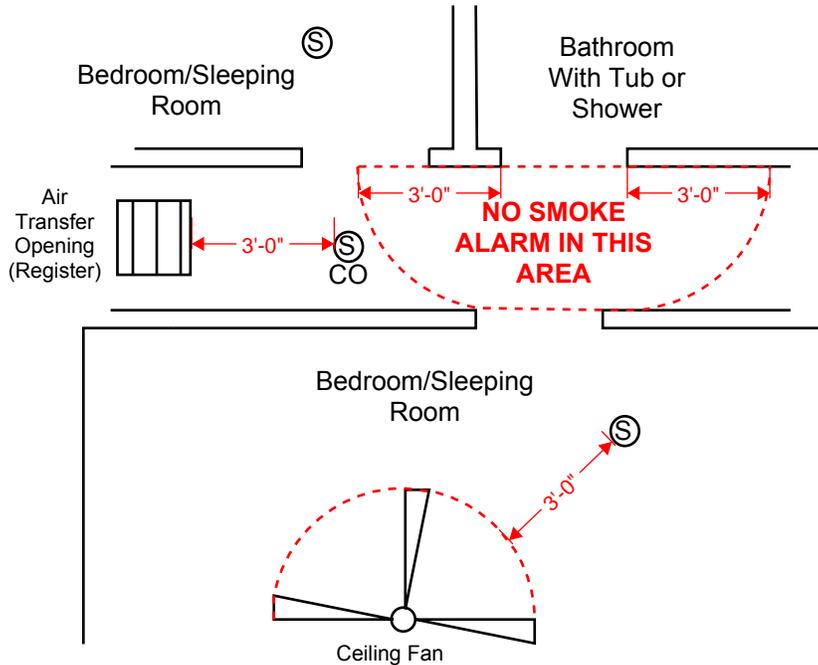

Smoke Alarms shall be installed:

- 1) Inside of EVERY Sleeping/Bedroom Room
- 2) Outside each sleeping area in the immediate vicinity of the Bedrooms
- 3) On each level (Story) including Basements and Habitable Attics
- 4) Within 3' of highest point
- 5) **At least 3' from door to bathrooms containing a tub or shower, from an air transfer opening or the tip of ceiling fan blades**

* Smoke Alarms will be required when Alterations, Repairs or Additions requiring a Permit occur
(Except: Roofing, Siding, Windows, Doors, Porch, Deck, Mechanical or Plumbing)

* Smoke Alarms shall receive primary power from building wiring with battery back-up
(Hard wiring is not required in existing areas where alterations do not result in the removal of interior wall or ceiling finishes unless there is an attic, basement or crawl space that provides access for hard wiring)

* Where more than One Smoke Alarm is required in a Dwelling they shall be interconnected
(Interconnection is not required in existing areas where alterations do not result in the removal of interior wall or ceiling finishes unless there is an attic, basement or crawl space that provides access for hard wiring)

Carbon Monoxide Alarms shall be installed Outside of ALL Sleeping areas in the immediate vicinity of Bedrooms in Dwellings containing Fuel-Fired Appliances or having an Attached Garage

* Carbon Monoxide Alarms will be required when Alterations, Repairs or Additions requiring a Permit occur (Except: Roofing, Siding, Windows, Doors, Porch, Deck, Mechanical or Plumbing)

* Carbon Monoxide Alarms shall receive primary power from building wiring with battery back-up
(Hard wiring is not required in existing areas where alterations do not result in the removal of interior wall or ceiling finishes unless there is an attic, basement or crawl space that provides access for hard wiring)

Combination Smoke/Carbon Monoxide Alarms may be used