Sheridan WYOMING

Building Department

STAIRWAY REQUIREMENTS

Revised 12/15

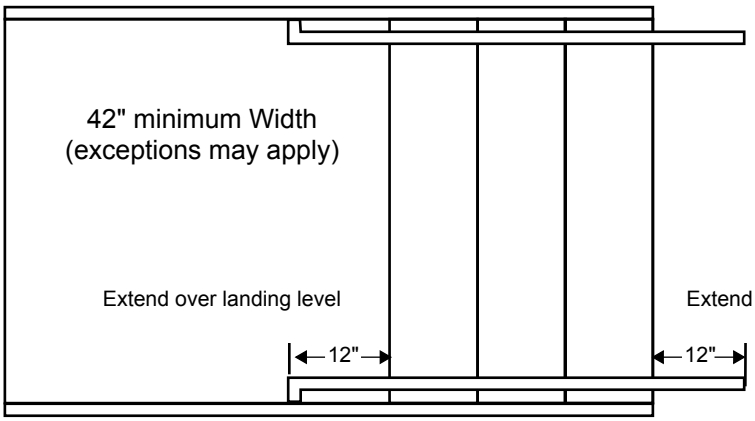

COMMERCIAL STAIRWAY REQUIREMENTS

Extend past bottom tread nose following slope

Handrails must return to Wall or Guard

Minimum Rise 4"
Maximum Rise 7"
Minimum Tread Depth 11"
Open Risers Cannot Exceed 4" Spacing

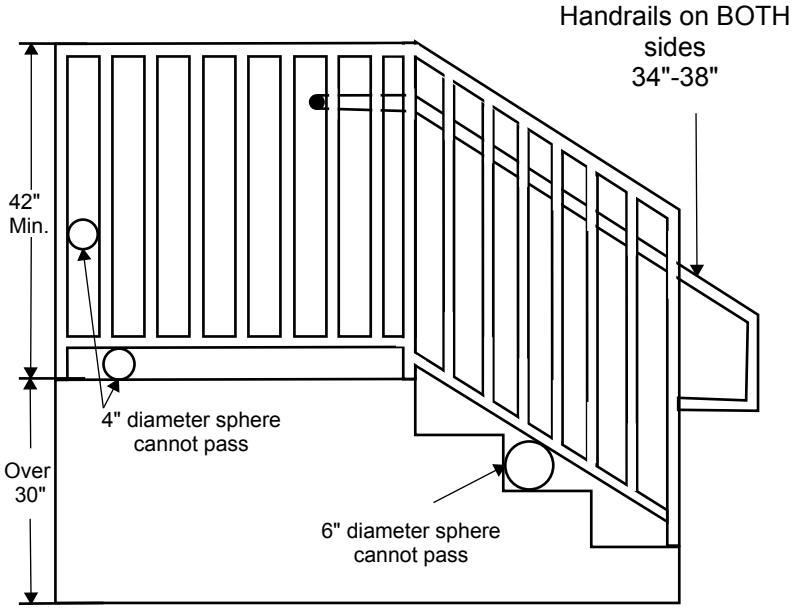

RESIDENTIAL STAIRWAY REQUIREMENTS
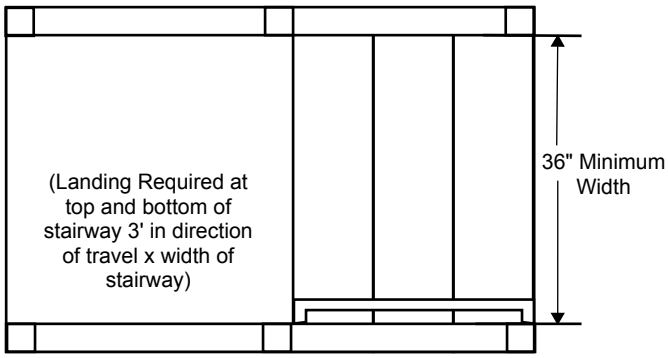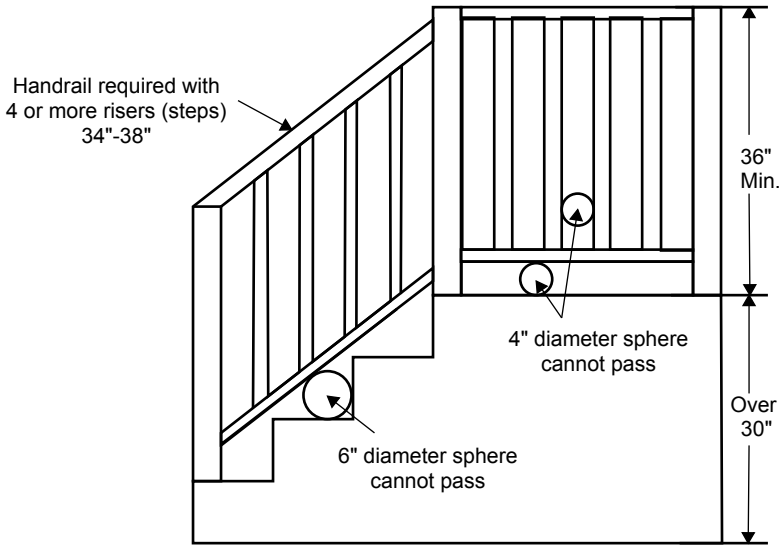
Maximum Rise 7 3/4"
Minimum Tread Depth 10"
Open Risers Cannot Exceed 4" Spacing