Sheridan WYOMING

Building Department

TYPICAL ONE-LINE ELECTRICAL DIAGRAM

Revised 12/15

General	Part I
Overhead Service Conductors	Part II
Underground Service Conductors	Part III
Service Entrance Conductors	Part IV
Service Equipment	Part V
Service Equipment -- Disconnecting Means	Part VI
Service Equipment -- Overcurrent Protection	Part VII
Services Exceeding 1000 Volts, Nominal	Part VIII

Complete Information In Red Boxes

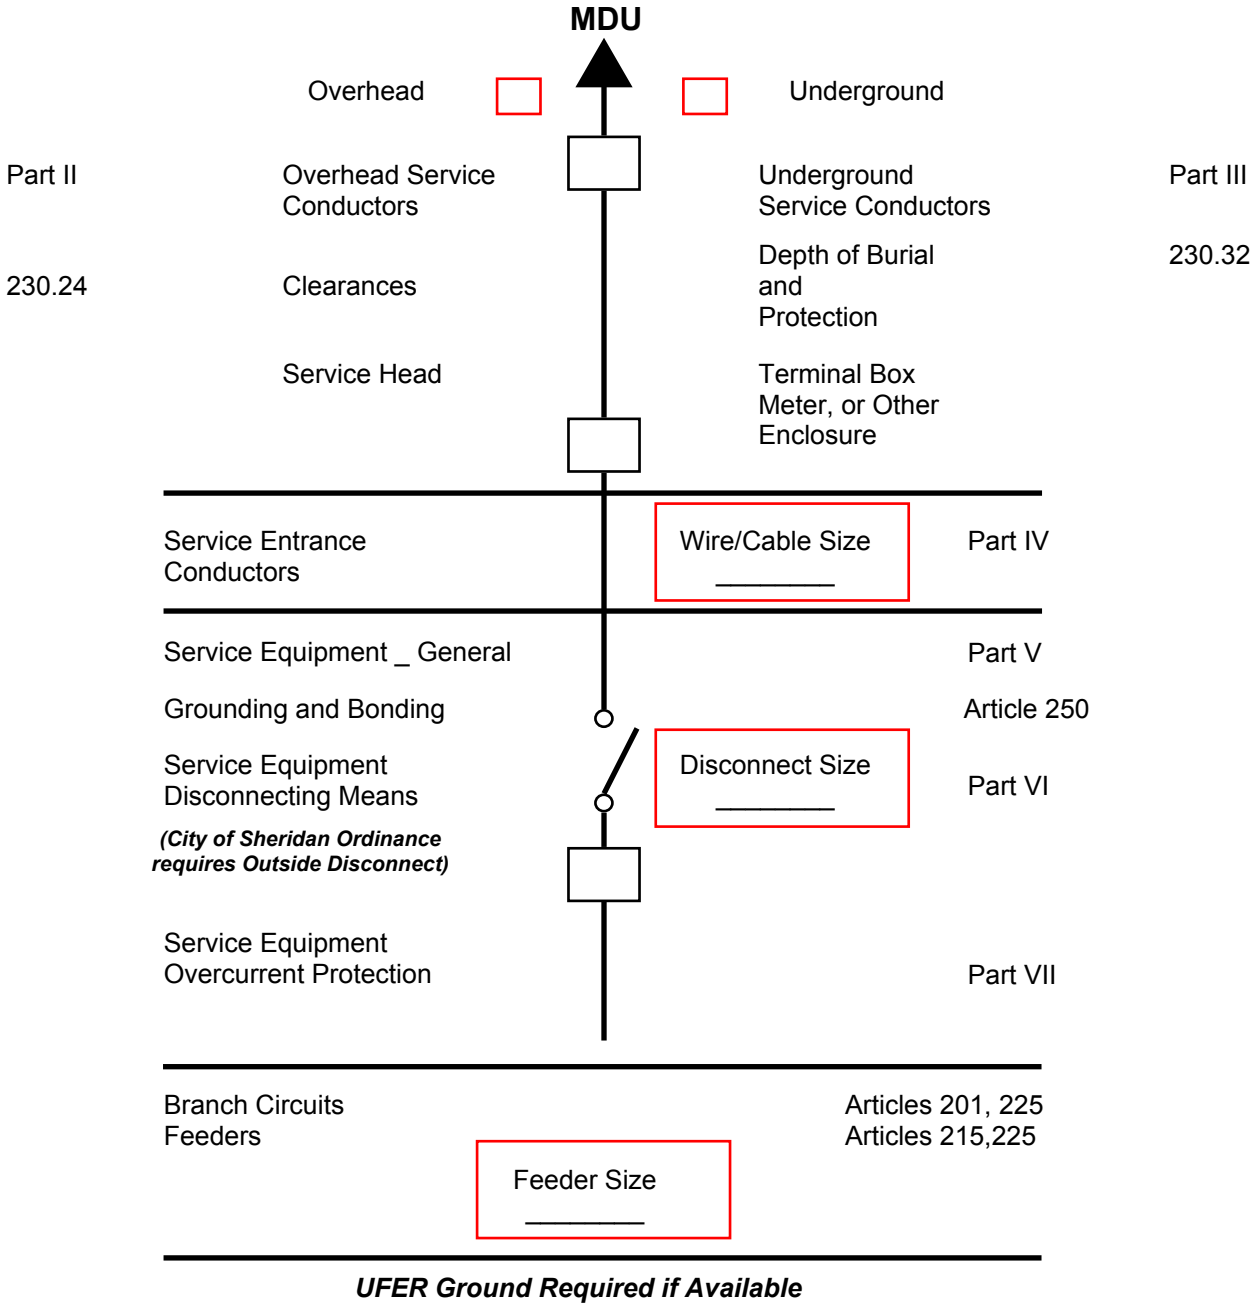

UFER Ground Required if Available

2014 National Electrical Code Enforced